

Job Name/Location

Tag #:

Date:

| | | |
|------|----------|------------|
| For: | File | Resubmit |
| | Approval | Other_____ |

PO No.:

Architect: GC:

Engr: Mech:

Rep: (Company) (Project Manager)



ZPLT1A52A

Multi V™ 5 8.0 - 20.0 Ton ODU Drain Pan Heater

208-230V/ 60Hz/ 1Ø, 599W



Electrical:

| | |
|----------------------|--|
| Power Requirements | Connect line voltage power to external fused disconnect per wiring schematic |
| Control Requirements | Block Wiring harness plugs into ODU control board Terminal |
| Capacity (W) | 599 |
| Amps (A) | 2.88 |
| MOP (A) | 6.48 |
| MCA (A) | 3.6 |
| Fuses (Quantity: 2) | Bussman Series KTK-3 |
| Weight (lbs.) | 12 |

MCA - Minimum Circuit Ampacity

MOP - Maximum Overcurrent Protection

Compatibility:

Multi V™ 5 Outdoor Units

ARUM096BTE5-ARUM241BTE5

Do Not Bend Heater At
These Points



Kit Components

| | |
|--|--------------|
| 1. Tubular Heater Element (149 inches) (CSA Listed) | Quantity: 1 |
| 2. Contactor Box Subassembly | Quantity: 1 |
| 3. Heater Contactor | Quantity: 1 |
| 4. Control Signal Harness | Quantity: 1 |
| 5. Rubber Fuseholder Covers | Quantity: 4 |
| 6. Incoming Power Fuseholders | Quantity: 2 |
| 7. Incoming Power Fuses | Quantity: 2 |
| 8. Control Box Grommets | Quantity: 2 |
| 9. Heater Routing Clamps | Quantity: 10 |
| 10. Contactor Box Mounting Plate Screws (Self-tapping) | Quantity: 2 |
| 11. Self-drilling Screws | Quantity: 12 |
| 12. Heater Information Label | Quantity: 12 |

Notes:

- Follow all installation instructions in the Drain Pan Heater Installation manual.
- As a safety precaution, the heater(s) will not energize if the outdoor ambient temperature is above 39°F.

ZPLT1A52A

Multi V™ 5 8.0 - 20.0 Ton ODU Drain Pan Heater


208-230V/ 60Hz/ 1Ø, 599W



Tag No.: _____

Date: _____

PO No.: _____

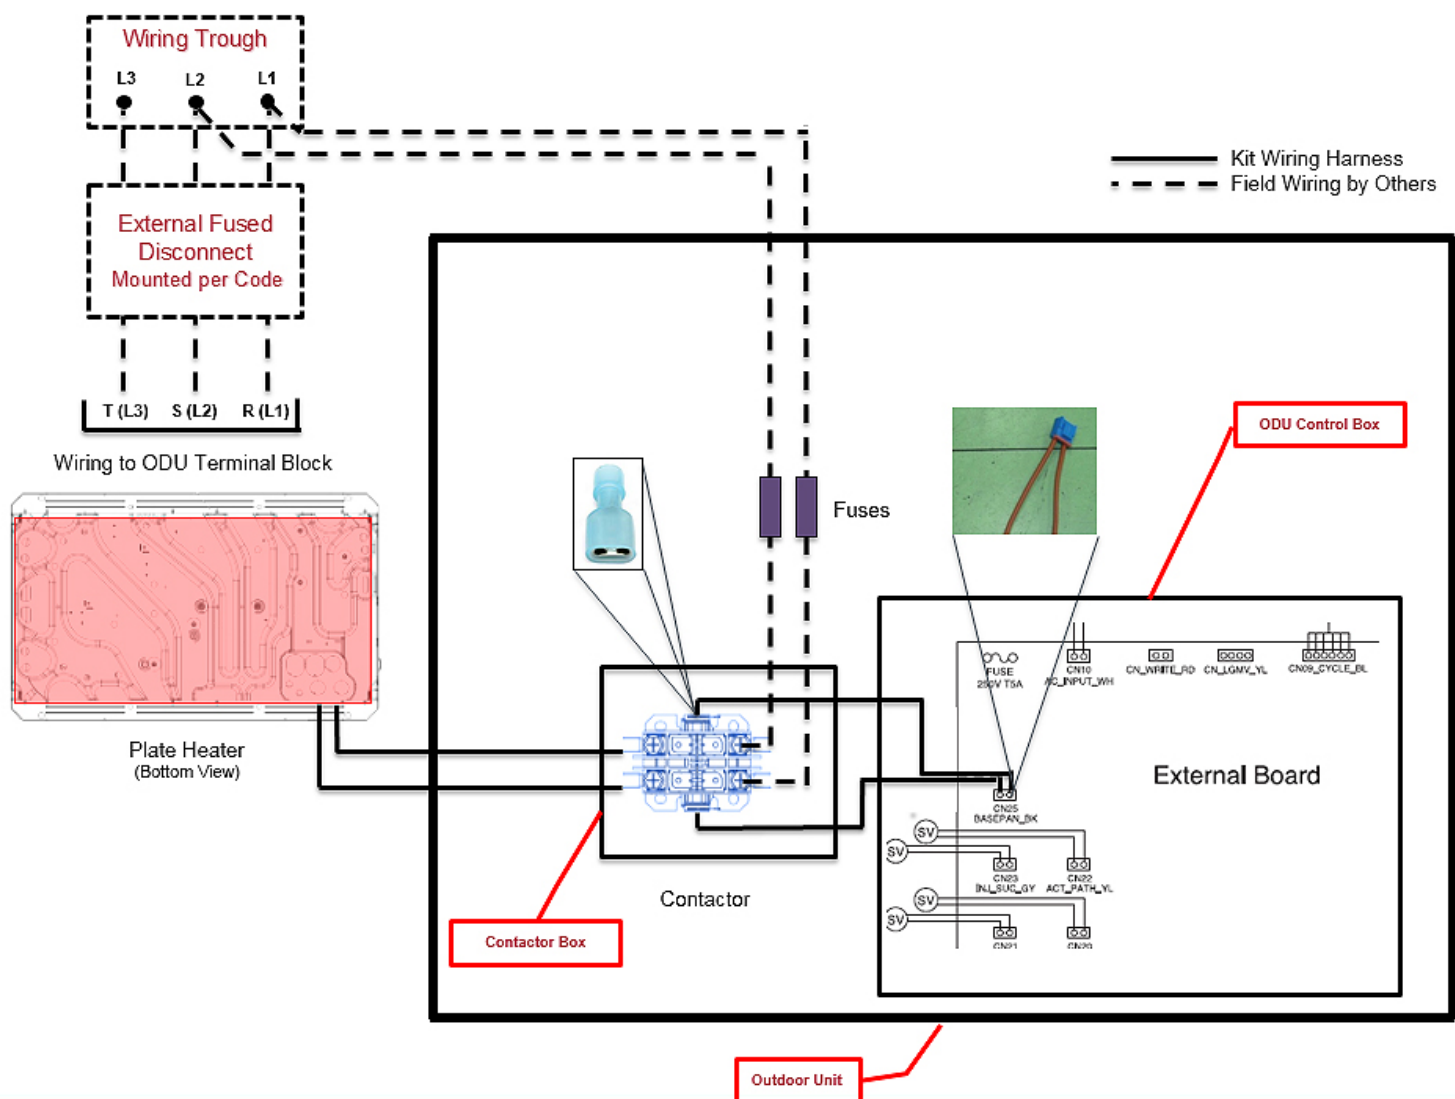

Job Name/Location _____












ZPLT1A52A
Multi V™ 5 8.0 - 20.0 Ton ODU Drain Pan Heater
 208-230V/ 60Hz/ 1Ø, 599W



Tag No.: _____

Date: _____

PO No.: _____

| Part | Quantity | Image |
|--|----------|---|
| Control Box Assembly | 1 |  |
| Control Signal Harness | 1 |  |
| Heater Contactor | 1 |  |
| Rubber Fuseholder Covers | 4 |  |
| Incoming Power Fuse Holder | 1 |  |
| Incoming Power Fuse (KTK-3) | 2 |  |
| Tubular Heater Element 599W/ (149 inches) (CSA Listed) | 1 |  |
| 1/4" Attachment Clamps | 10 |  |
| Control Box Grommets | 2 |  |
| Self-drilling Screws | 12 |  |
| Slot Screws | 2 |  |

Part: Additional Unit Label

Quantity: 1

208-230V Heat Pump/ Recovery Units.

| Model Number | Accessory | Unit Model Number | Tonnage | Wattage | Voltage | AMPS | Fuse |
|--------------|-----------------|-------------------------|---------|---------|---------|------|-------|
| ZPLT1A51A | Base Pan Heater | ARUM072BTE5 | 6 | 498 | 208 | 2.39 | KTK-3 |
| ZPLT1A52A | Base Pan Heater | ARUM096BTE5-ARUM241BTE5 | 8-20 | 599 | 208 | 2.88 | KTK-3 |

460V Heat Pump/ Recovery Units.

| Model Number | Accessory | Unit Model Number | Tonnage | Wattage | Voltage | AMPS | Fuse |
|--------------|-----------------|-------------------------|---------|---------|---------|------|-----------|
| ZPLT2A51A | Base Pan Heater | ARUM072DTE5 | 6 | 633 | 460 | 1.38 | KTK-1 1/2 |
| ZPLT2A52A | Base Pan Heater | ARUM096DTE5-ARUM241DTE5 | 8-20 | 761 | 460 | 1.65 | KTK-2 |